

10440 Ashford Street, Rancho Cucamonga, CA 91730
 Phone: (855) 654-CVWD
 Business Hours: Monday – Thursday 7:30 am – 5:30 pm
 Friday 7:30 am – 4:30 pm

Construction Water Meter Application and Guidelines

Applicant Billing Information			
Company Name:			
Billing Address:			
Billing Phone #:		Tax Id Number:	
Field Contact Name:		Field Contact Phone #:	
Check One: <small>(Recycled Water availability is based upon meter location)</small>	Potable <input type="checkbox"/>	Recycled <input type="checkbox"/>	General Meter Location:

For Office Use Only							
Acct #		Meter #		Installation Date		CSR	

Deposit Guidelines

- A \$2,000.00 deposit, paid in advance is required for construction meter sizes up to 3”.
- A \$3,500.00 deposit paid in advance is required for construction meter sizes 4” and above.
- Applicant will be charged for a replacement meter or repairs in the event the meter is damaged or stolen.
- Drawing water from a District hydrant without the use of a water meter, unauthorized removal of the meter and tampering with the meter or locking device will result in a forfeiture of the deposit.
- Only District staff is authorized to move construction meters. If relocation is required, the applicant must notify the District one business day in advance.


Backflow Requirements

- R.P. backflow assembly required if using more than 100’ of hose after the meter.
- All pre-soaks will require and R.P. type backflow assembly. Inspections are required.
- Air gap distance between bottom end of the water pipe and flood rim of the inlet water tank must be (2) the diameter of the water pipe.
- See STD. DWG. 124 Attached.
- See STD. DWG. 408 Attached.

The undersigned applicant accepts responsibility for payment of all charges for water services provided by the Cucamonga Valley Water District and agrees to comply with all District regulations governing such services outlined in the District’s municipal code.

Print Name _____ Date _____

Signature _____

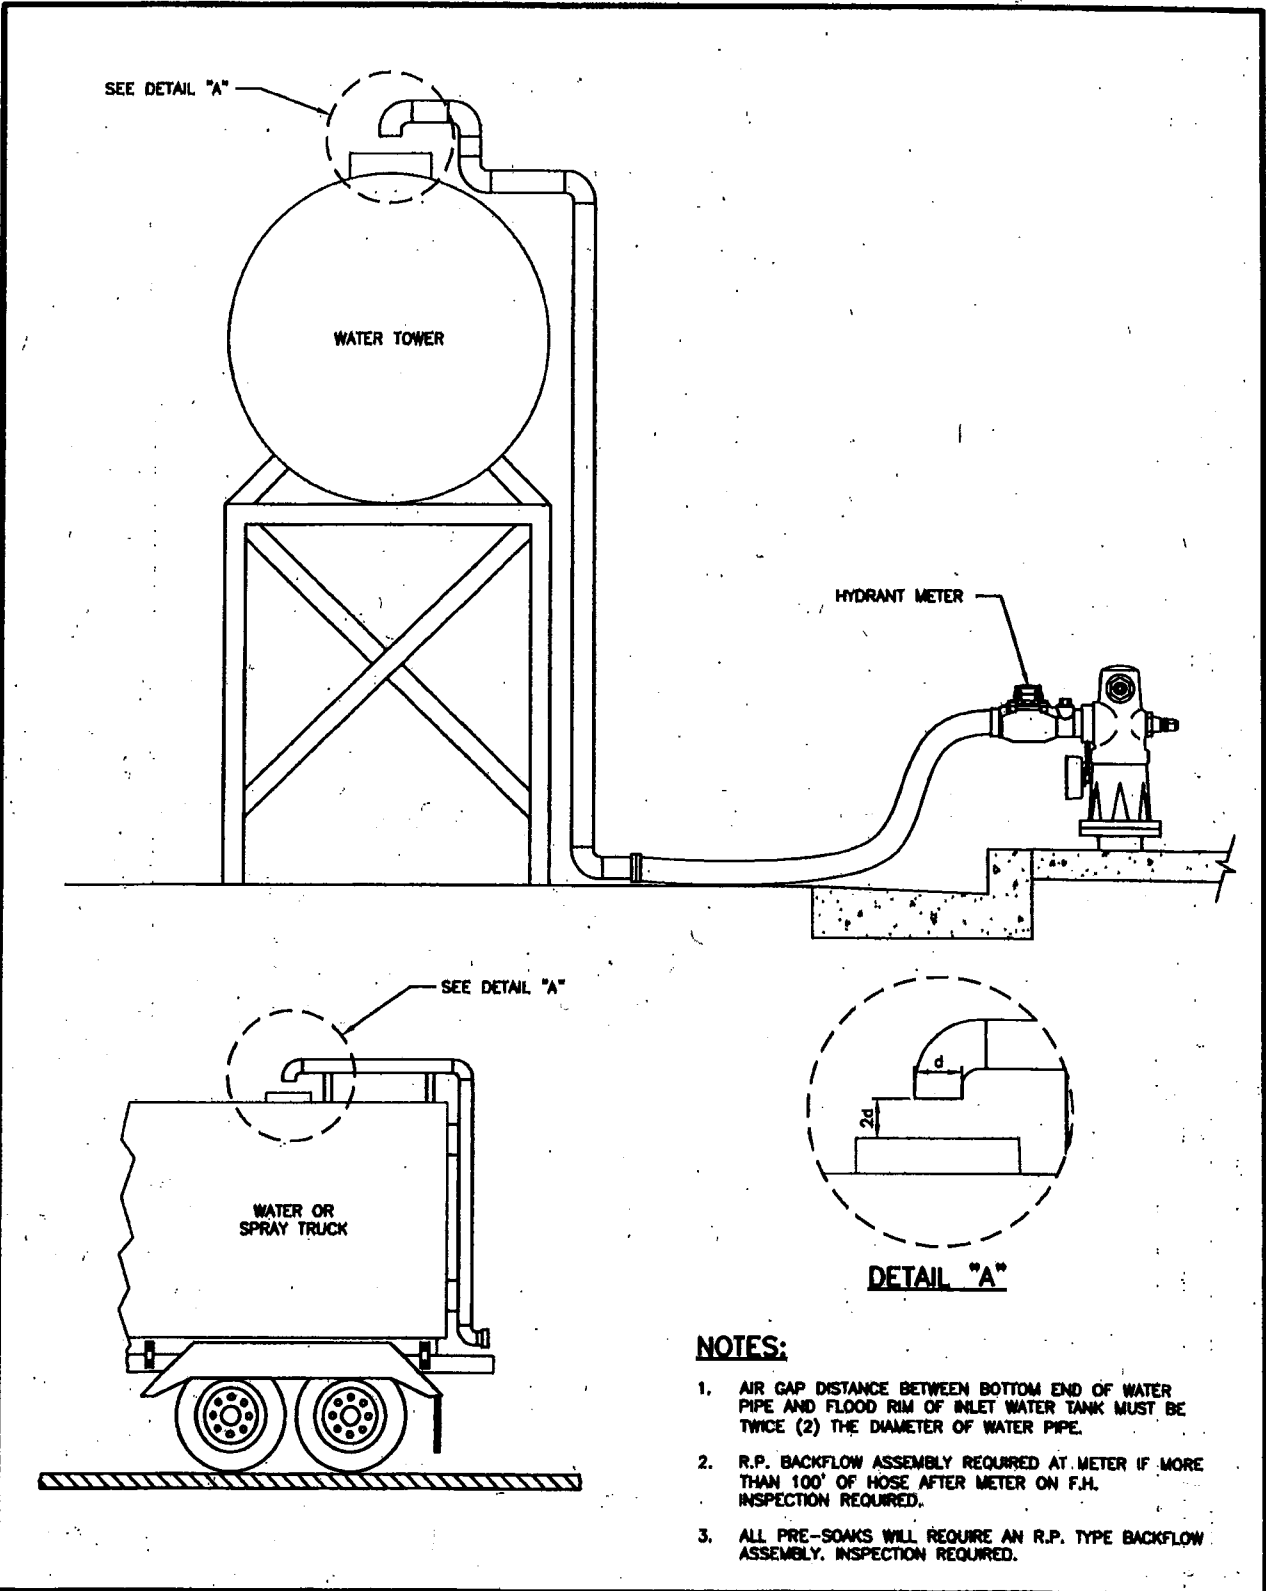

Cucamonga Valley Water District
INSTALLATION OF WATER PIPE TO WATER TRUCK AND TOWERS

Cucamonga Valley Water District
 ENGINEERING DEPARTMENT
 10440 ASHFORD STREET, RANCHO CUCAMONGA, CA 91728
 (909) 987-2581

APPROVED BY: *John Bosler*
 JOHN BOSLER P.E., DIRECTOR OF OPERATIONS & DATE
 ENGINEERING 6-11-09

STD. DWG.
 124
 SHT. 1 OF 1

